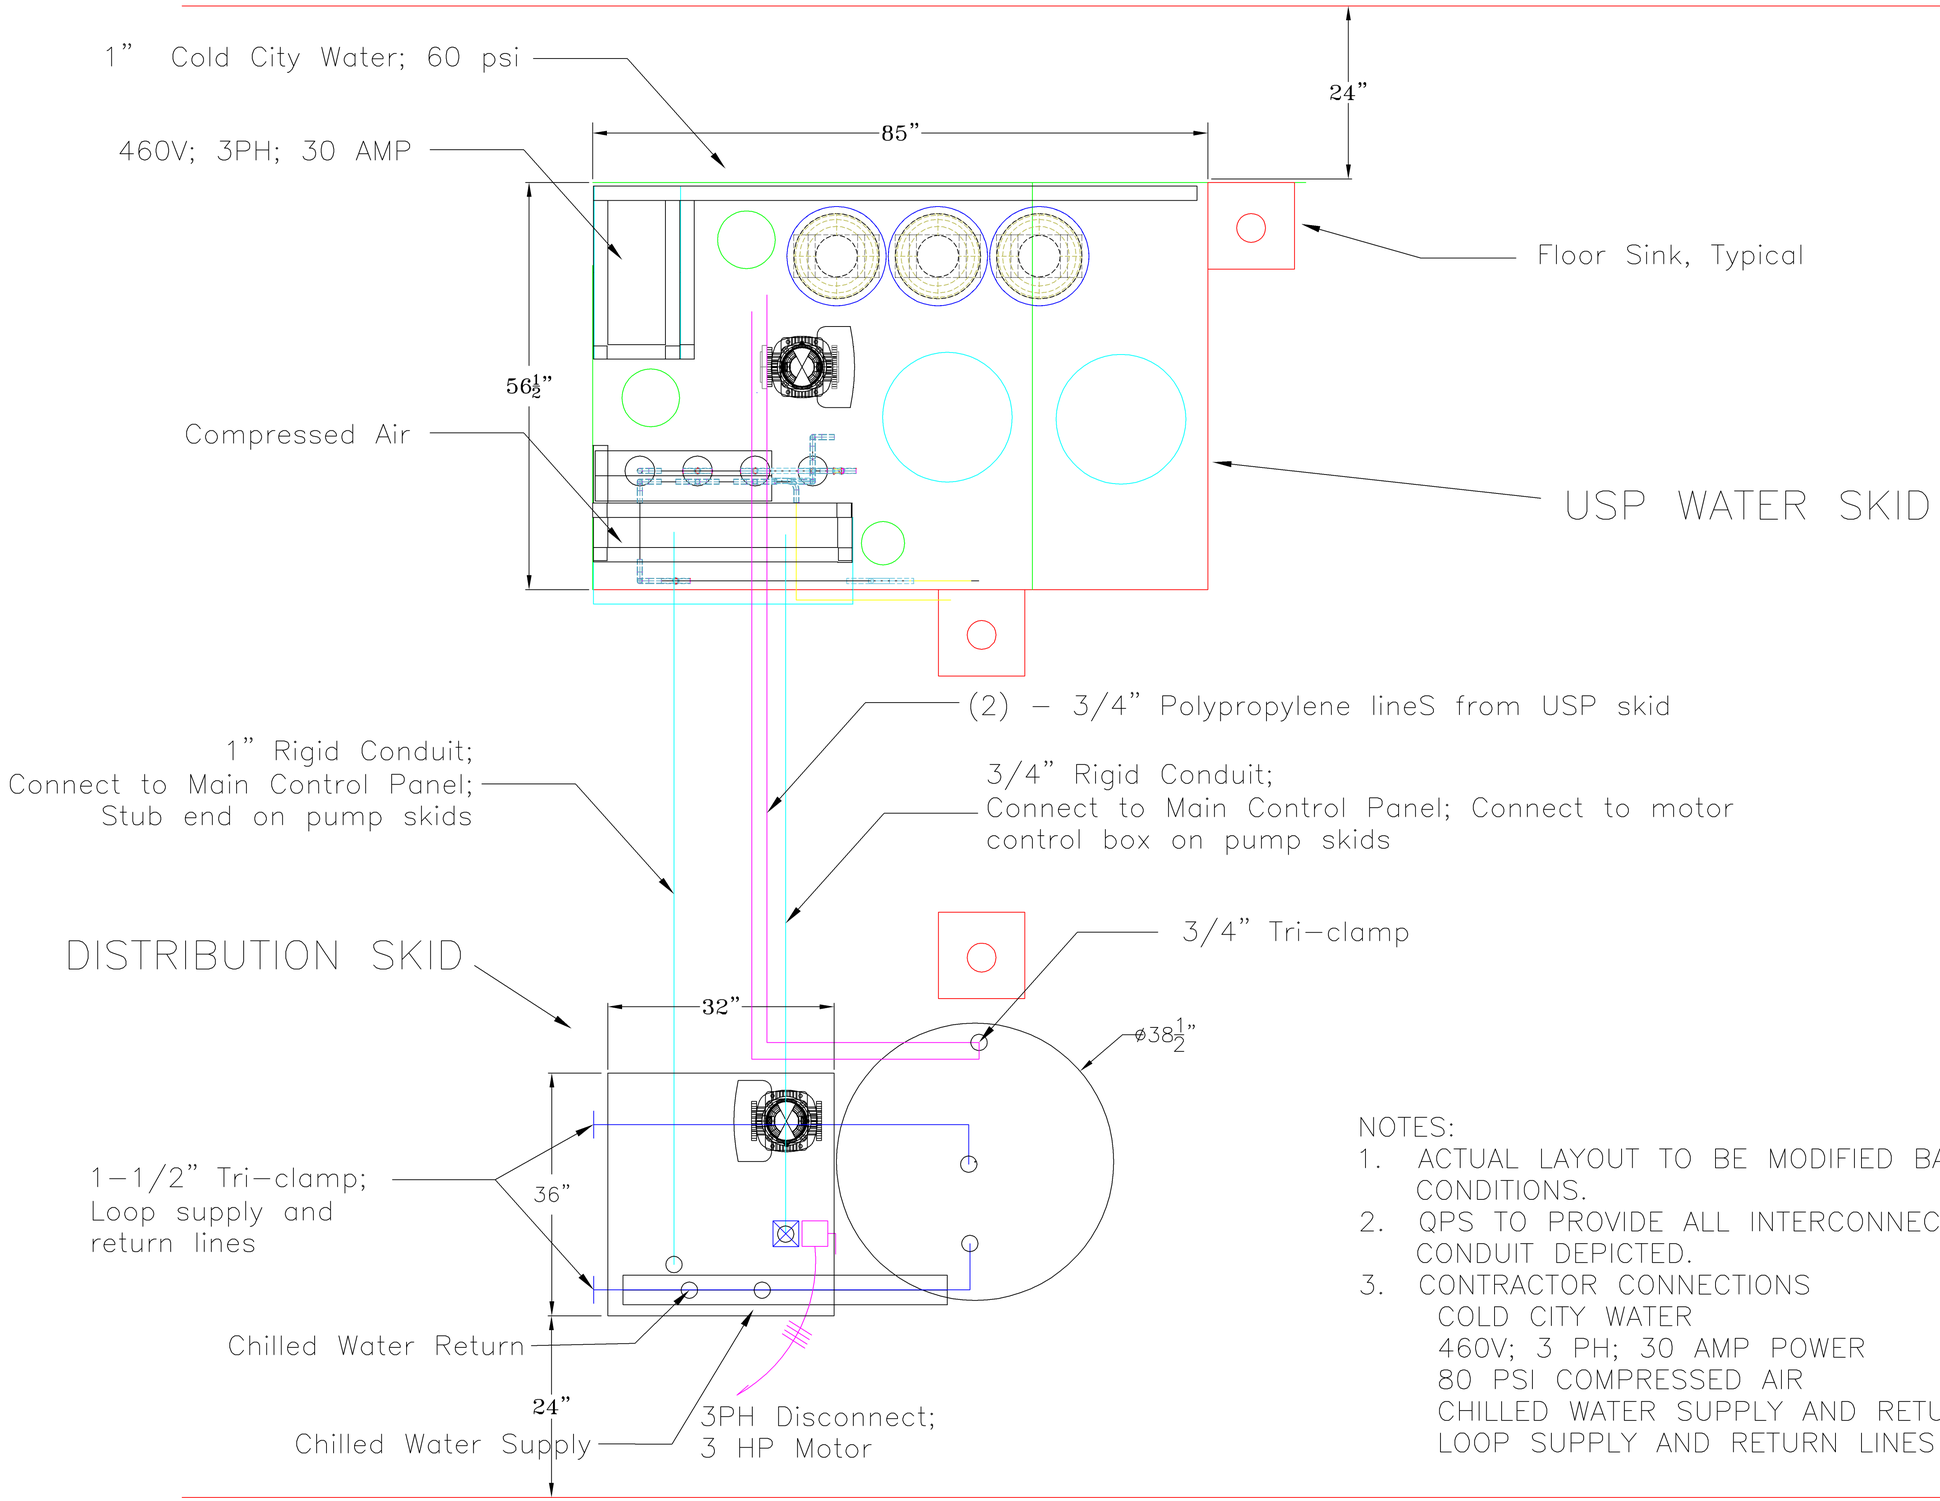

NOTES:

1. ACTUAL LAYOUT TO BE MODIFIED BASED ON FIELD CONDITIONS.
2. QPS TO PROVIDE ALL INTERCONNECTING PIPING AND CONDUIT DEPICTED.
3. CONTRACTOR CONNECTIONS
   COLD CITY WATER
   460V; 3 PH; 30 AMP POWER
   80 PSI COMPRESSED AIR
   CHILLED WATER SUPPLY AND RETURN
   LOOP SUPPLY AND RETURN LINES

THIS DRAWING IS THE PROPERTY OF QPS, LLC., AND IS NOT BE REPRODUCED, COPIED OR USED FOR ANY PURPOSE OTHER THAN CONSTRUCTION OF THIS PROJECT WITHOUT THE WRITTEN CONSENT OF QPS, LLC.

SEAL

SEAL

REVISIONS

DATE	BY	DESCRIPTION	REV
2/28/08	MM	CONCEPTUAL	1

PREPARED BY

Qualification Process Solutions
13406 Blythenia Road
Phoenix, MD 21131

PREPARED FOR

TITLE

PURIFIED WATER SYSTEM
GENERAL ARRANGEMENT

DESIGN BY	DRAWN BY	CHECKED BY
	MM	NB

SCALE	REVISION
NONE	1

DATE	DWG NO.
2/28/08	